




**IADC**

**IADC  
ISP PROGRAM**

**2018**

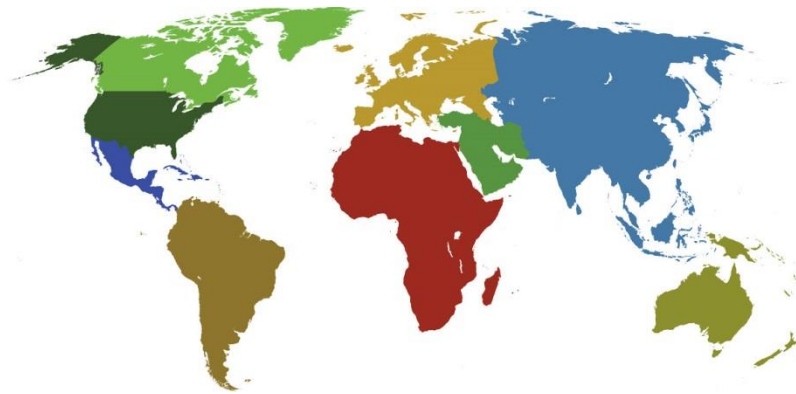

**Summary of Occupational  
Incidents  
(Australasia Water Totals)**

*Issued 15 June 2019*

# Table of Contents

(Table of Contents is Hyperlinked, Just click on Topic & go)


IADC 2018 AUSTRALASIA WATER TOTALS (TABLE 1).....	1
<i>Australasia Water Total Incidence Rates vs Man-hours (Figure 1)</i> .....	1
IADC 2018 AUSTRALASIA WATER CHARTS.....	2
<i>Australasia Water Total Recordable Incidents by Month (Chart 2)</i> .....	2
<i>Australasia Water Total Recordable Incidents by Occupation (Chart 4)</i> .....	3
<i>Australasia Water Total Recordable Incidents by Body Part (Chart 6)</i> .....	4
<i>Australasia Water Total Recordable Incidents by Incident Type (Chart 8)</i> .....	5
<i>Australasia Water Total Recordable Incidents by Equipment (Chart 10)</i> .....	6
<i>Australasia Water Total Recordable Incidents by Operation (Chart 12)</i> .....	7
<i>Australasia Water Total Recordable Incidents by Location (Chart 14)</i> .....	8
<i>Australasia Water Total Recordable Incidents by Time in Service (Chart 16)</i> .....	9
<i>Australasia Water Total Recordable Incidents by Time of Day (Chart 18)</i> .....	10
<i>Australasia Water Total Recordable Incidents by Age (Chart 19)</i> .....	11

## IADC 2018 Australasia Water Totals (Table 1)

	<u>Totals</u>
Total Manhours	1,278,455
Total Medical Treatment Incidents	0
Total Restricted Work Incidents	1
Total Lost Time Incidents	2
Total Fatalities	0
Total Recordables	3
MTO Incidence Rate	0.00
RWC Incidence Rate	0.16
LTI Incidence Rate	0.31
LTI Frequency Rate	1.56
DART Incidence Rate	0.47
DART Frequency Rate	2.35
Recordable Incidence Rate	0.47
Recordable Frequency Rate	2.35

MEDICAL TREATMENT INCIDENCE RATE = MTOs X 200,000 / MANHOURS (LTIs NOT INCLUDED)  
 RESTRICTED WORK INCIDENCE RATE = RWCs X 200,000 / MANHOURS (LTIs NOT INCLUDED)  
 LOST TIME INCIDENCE RATE = (LTIs+FTLs) X 200,000 / MANHOURS  
 LOST TIME FREQUENCY RATE = (LTIs+FTLs) X 1,000,000 / MANHOURS  
 DART INCIDENCE RATE = (LTIs+FTLs+RWCs) X 200,000 / MANHOURS  
 DART FREQUENCY RATE = (LTIs+FTLs+RWCs) X 1,000,000 / MANHOURS  
 RECORDABLE INCIDENCE RATE = RECORDABLES X 200,000 / MANHOURS  
 RECORDABLE FREQUENCY RATE = RECORDABLES X 1,000,000 / MANHOURS  
**Companies Reporting: Water – 4**

**Australasia Water Total Incidence Rates vs Man-hours (Figure 1)**

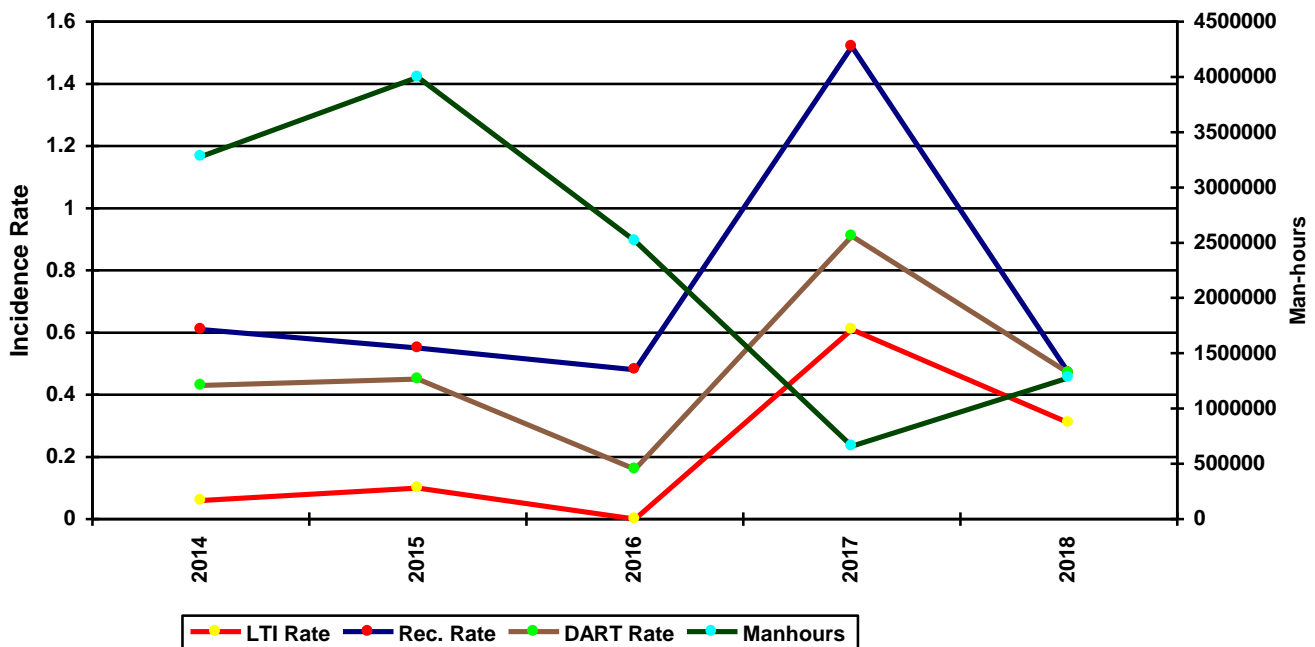


## IADC 2018 Australasia Water Charts


Note: There were only two Lost Time Incident recorded for 2018, therefore there will not be any charts.

### Australasia Water Total Recordable Incidents by Month (Chart 2)


Based on 3 Incidents

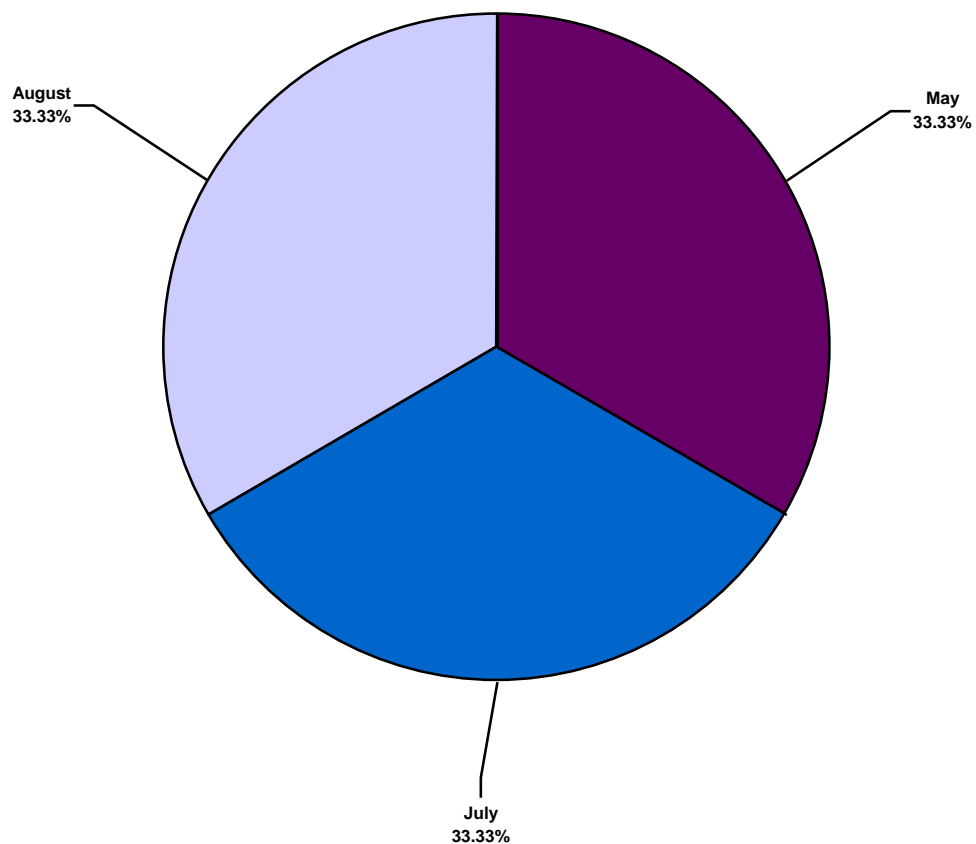


**Australasia Water Total Recordable Incidents by Occupation (Chart 4)**  
Based on 2 Incidents

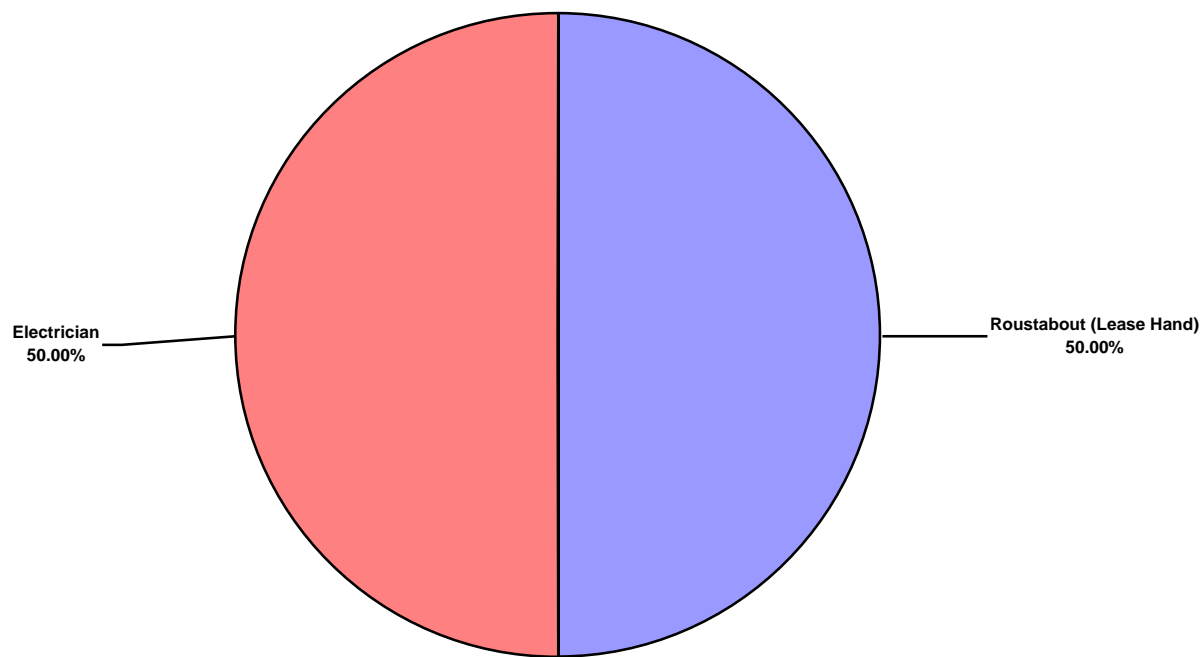


**Australasia Water Total Recordable Incidents by Body Part (Chart 6)**  
Based on 3 Incidents

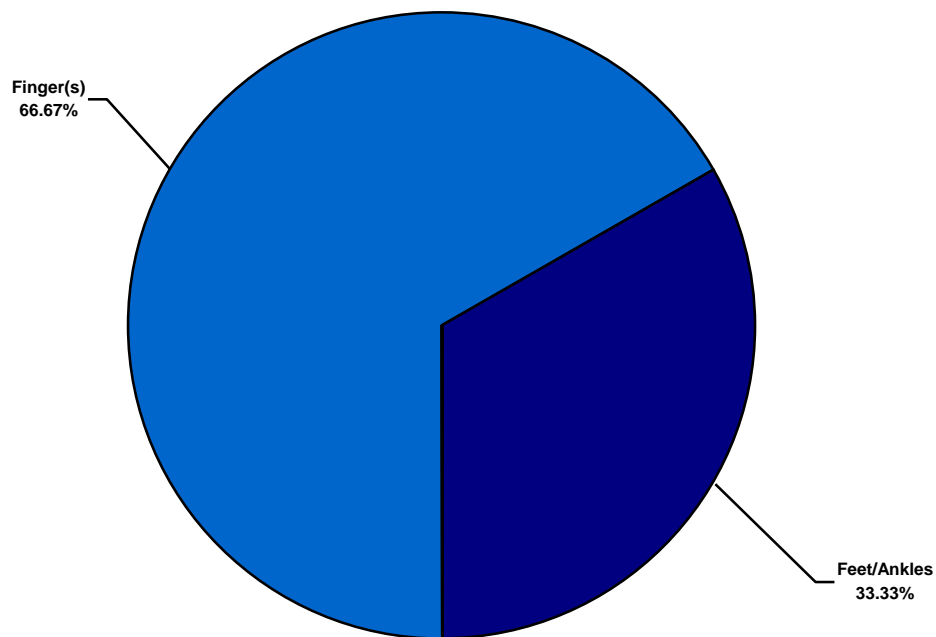

**Australasia Water Total Recordable Incidents by Incident Type (Chart 8)**  
Based on 2 Incidents

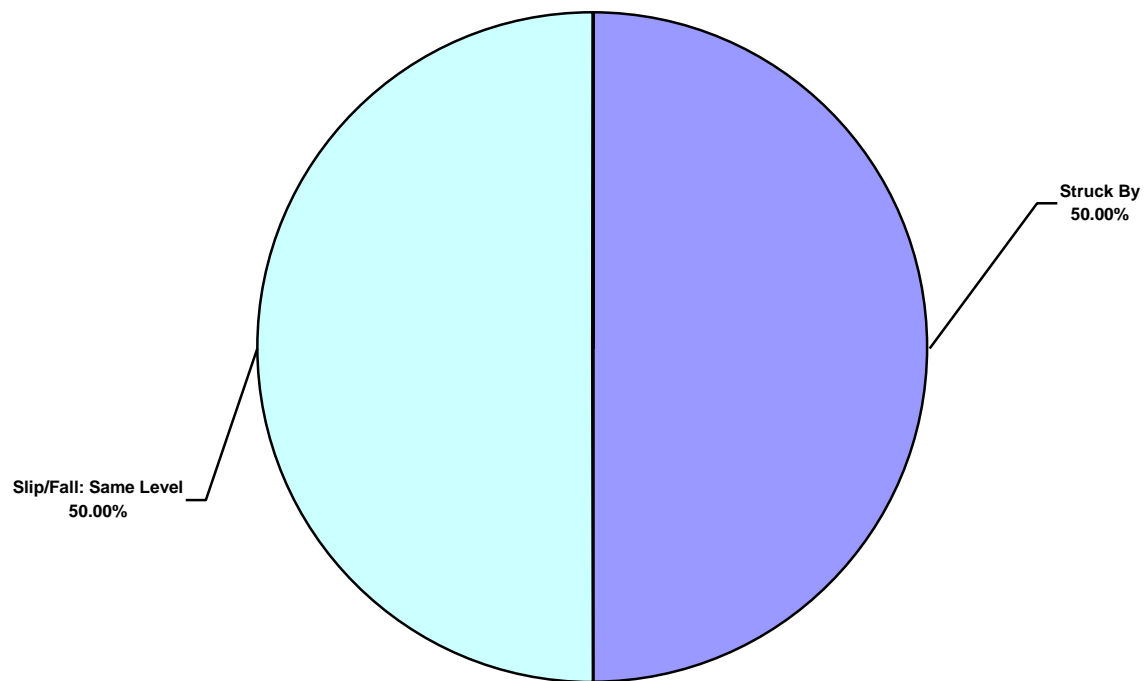


**Australasia Water Total Recordable Incidents by Equipment (Chart 10)**  
Based on 3 Incidents

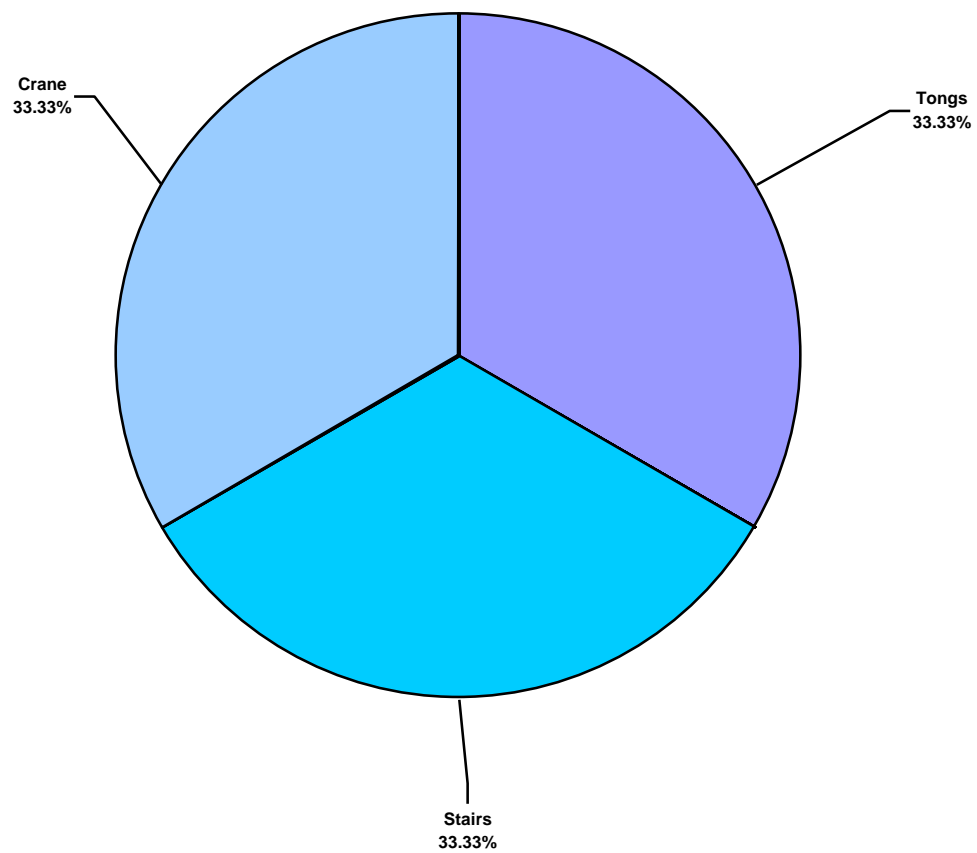





**Australasia Water Total Recordable Incidents by Operation (Chart 12)**  
Based on 3 Incidents

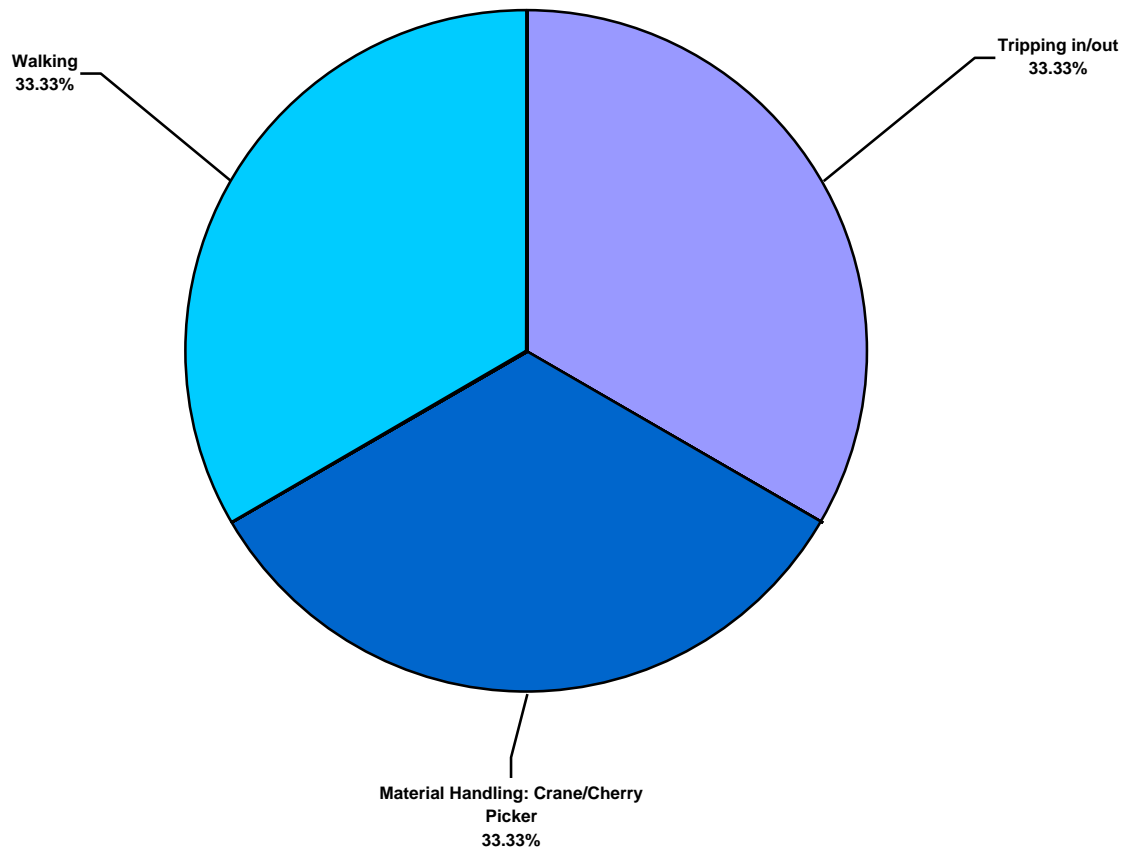


**Australasia Water Total Recordable Incidents by Location (Chart 14)**  
Based on 3 Incidents

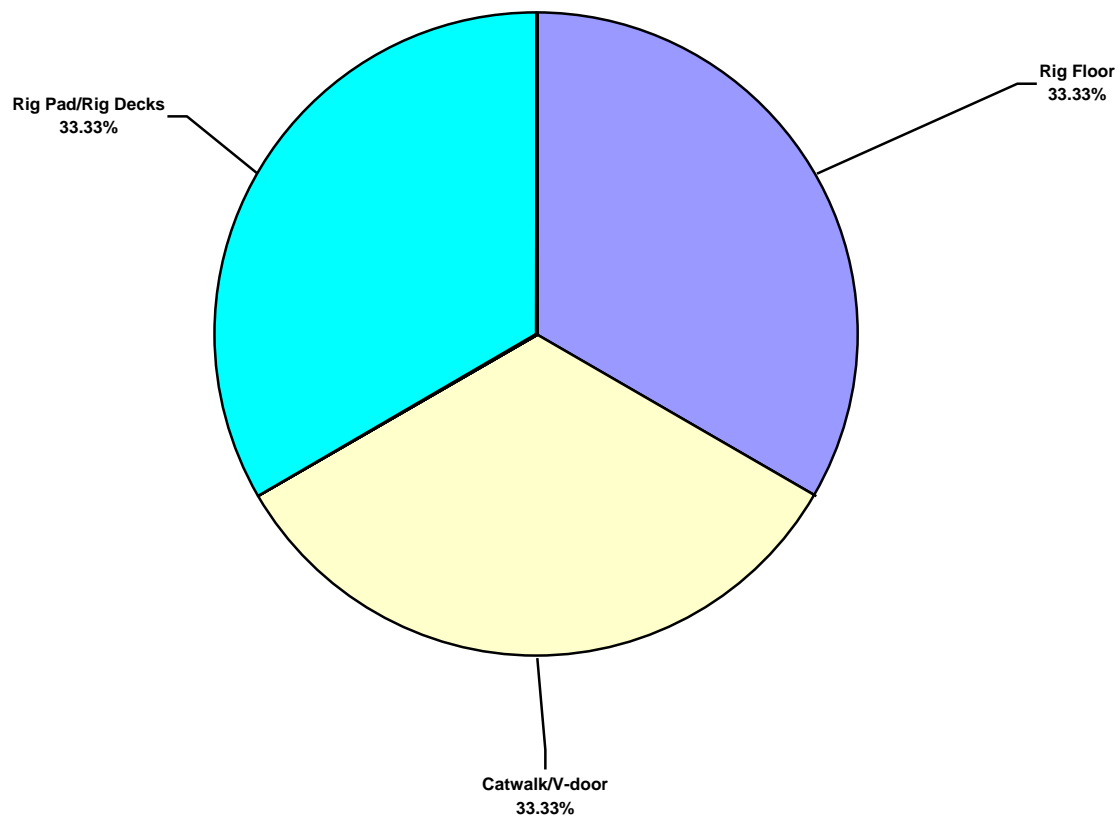

**Australasia Water Total Recordable Incidents by Time in Service (Chart 16)**  
Based on 3 Incidents

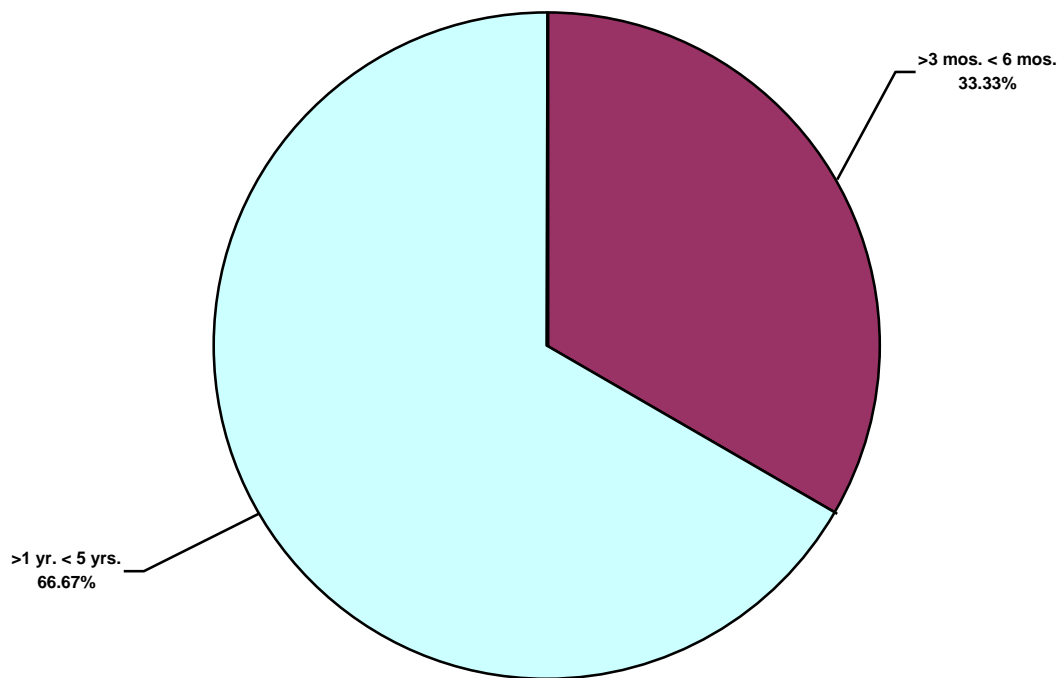

**Australasia Water Total Recordable Incidents by Time of Day (Chart 18)**  
Based on 3 Incidents

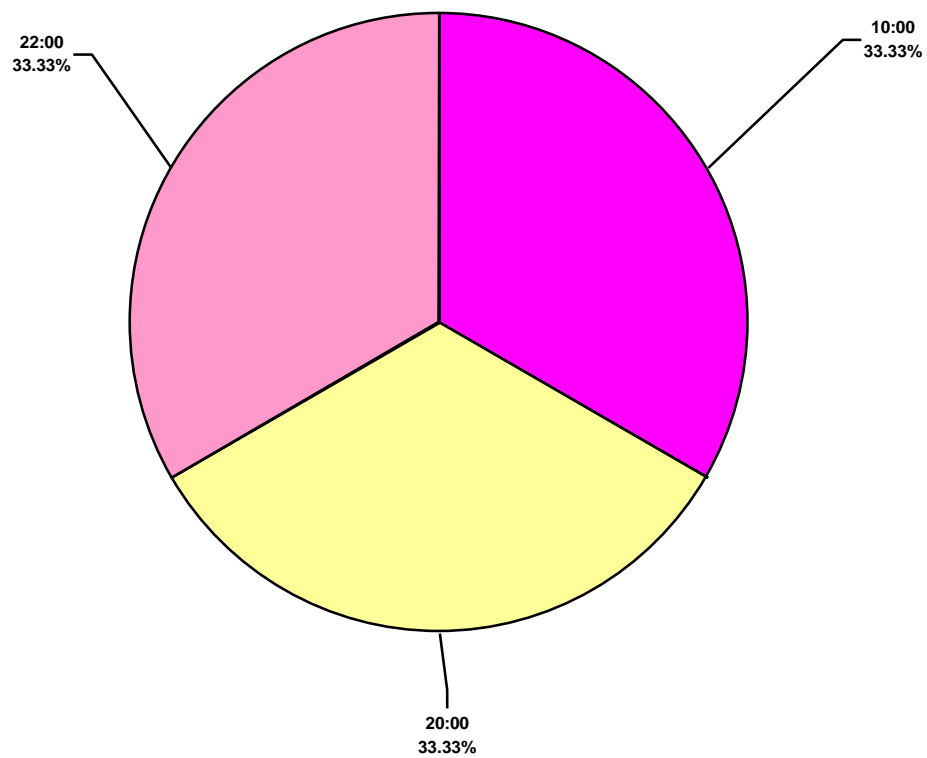

**Australasia Water Total Recordable Incidents by Age (Chart 19)**  
Based on 2 Incidents

